
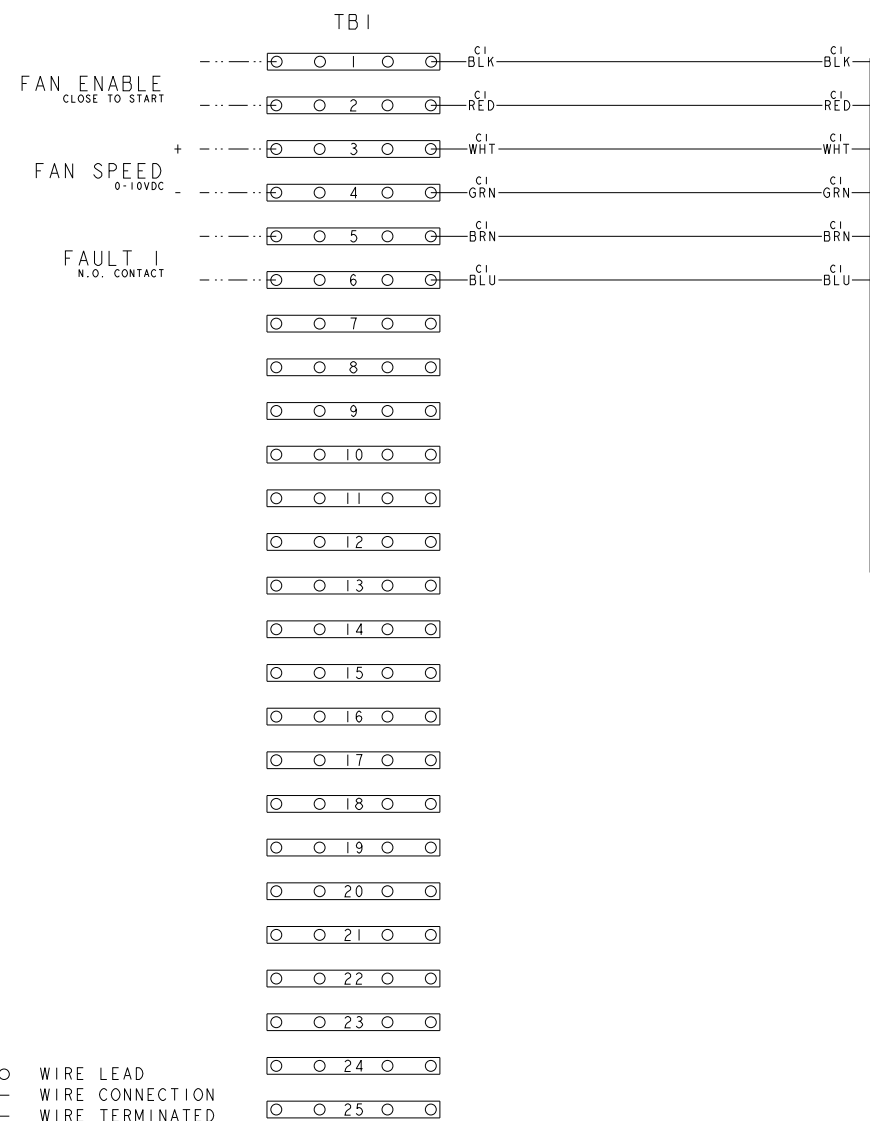



NOTES:


1. INSTALL IN ACCORDANCE WITH NATIONAL WIRING REGULATIONS
2. EXTERNAL CONDUIT AND POWER WIRING PROVIDED IN FIELD BY OTHERS
3. USE 75C COPPER CONDUCTORS ONLY
4. CONTROLS PROVIDED BY OTHERS, SPARE TERMINALS PROVIDED
5. EXCESS PLENUM RATED CONTROL CABLE BUNDLED FOR FIELD WIRING

TITLE	
CONN DIAG 1MOT WO/EH 30A AH*	
DWG NO	REV
1000-00638673	A
STATE: Released	VERSION: A.2

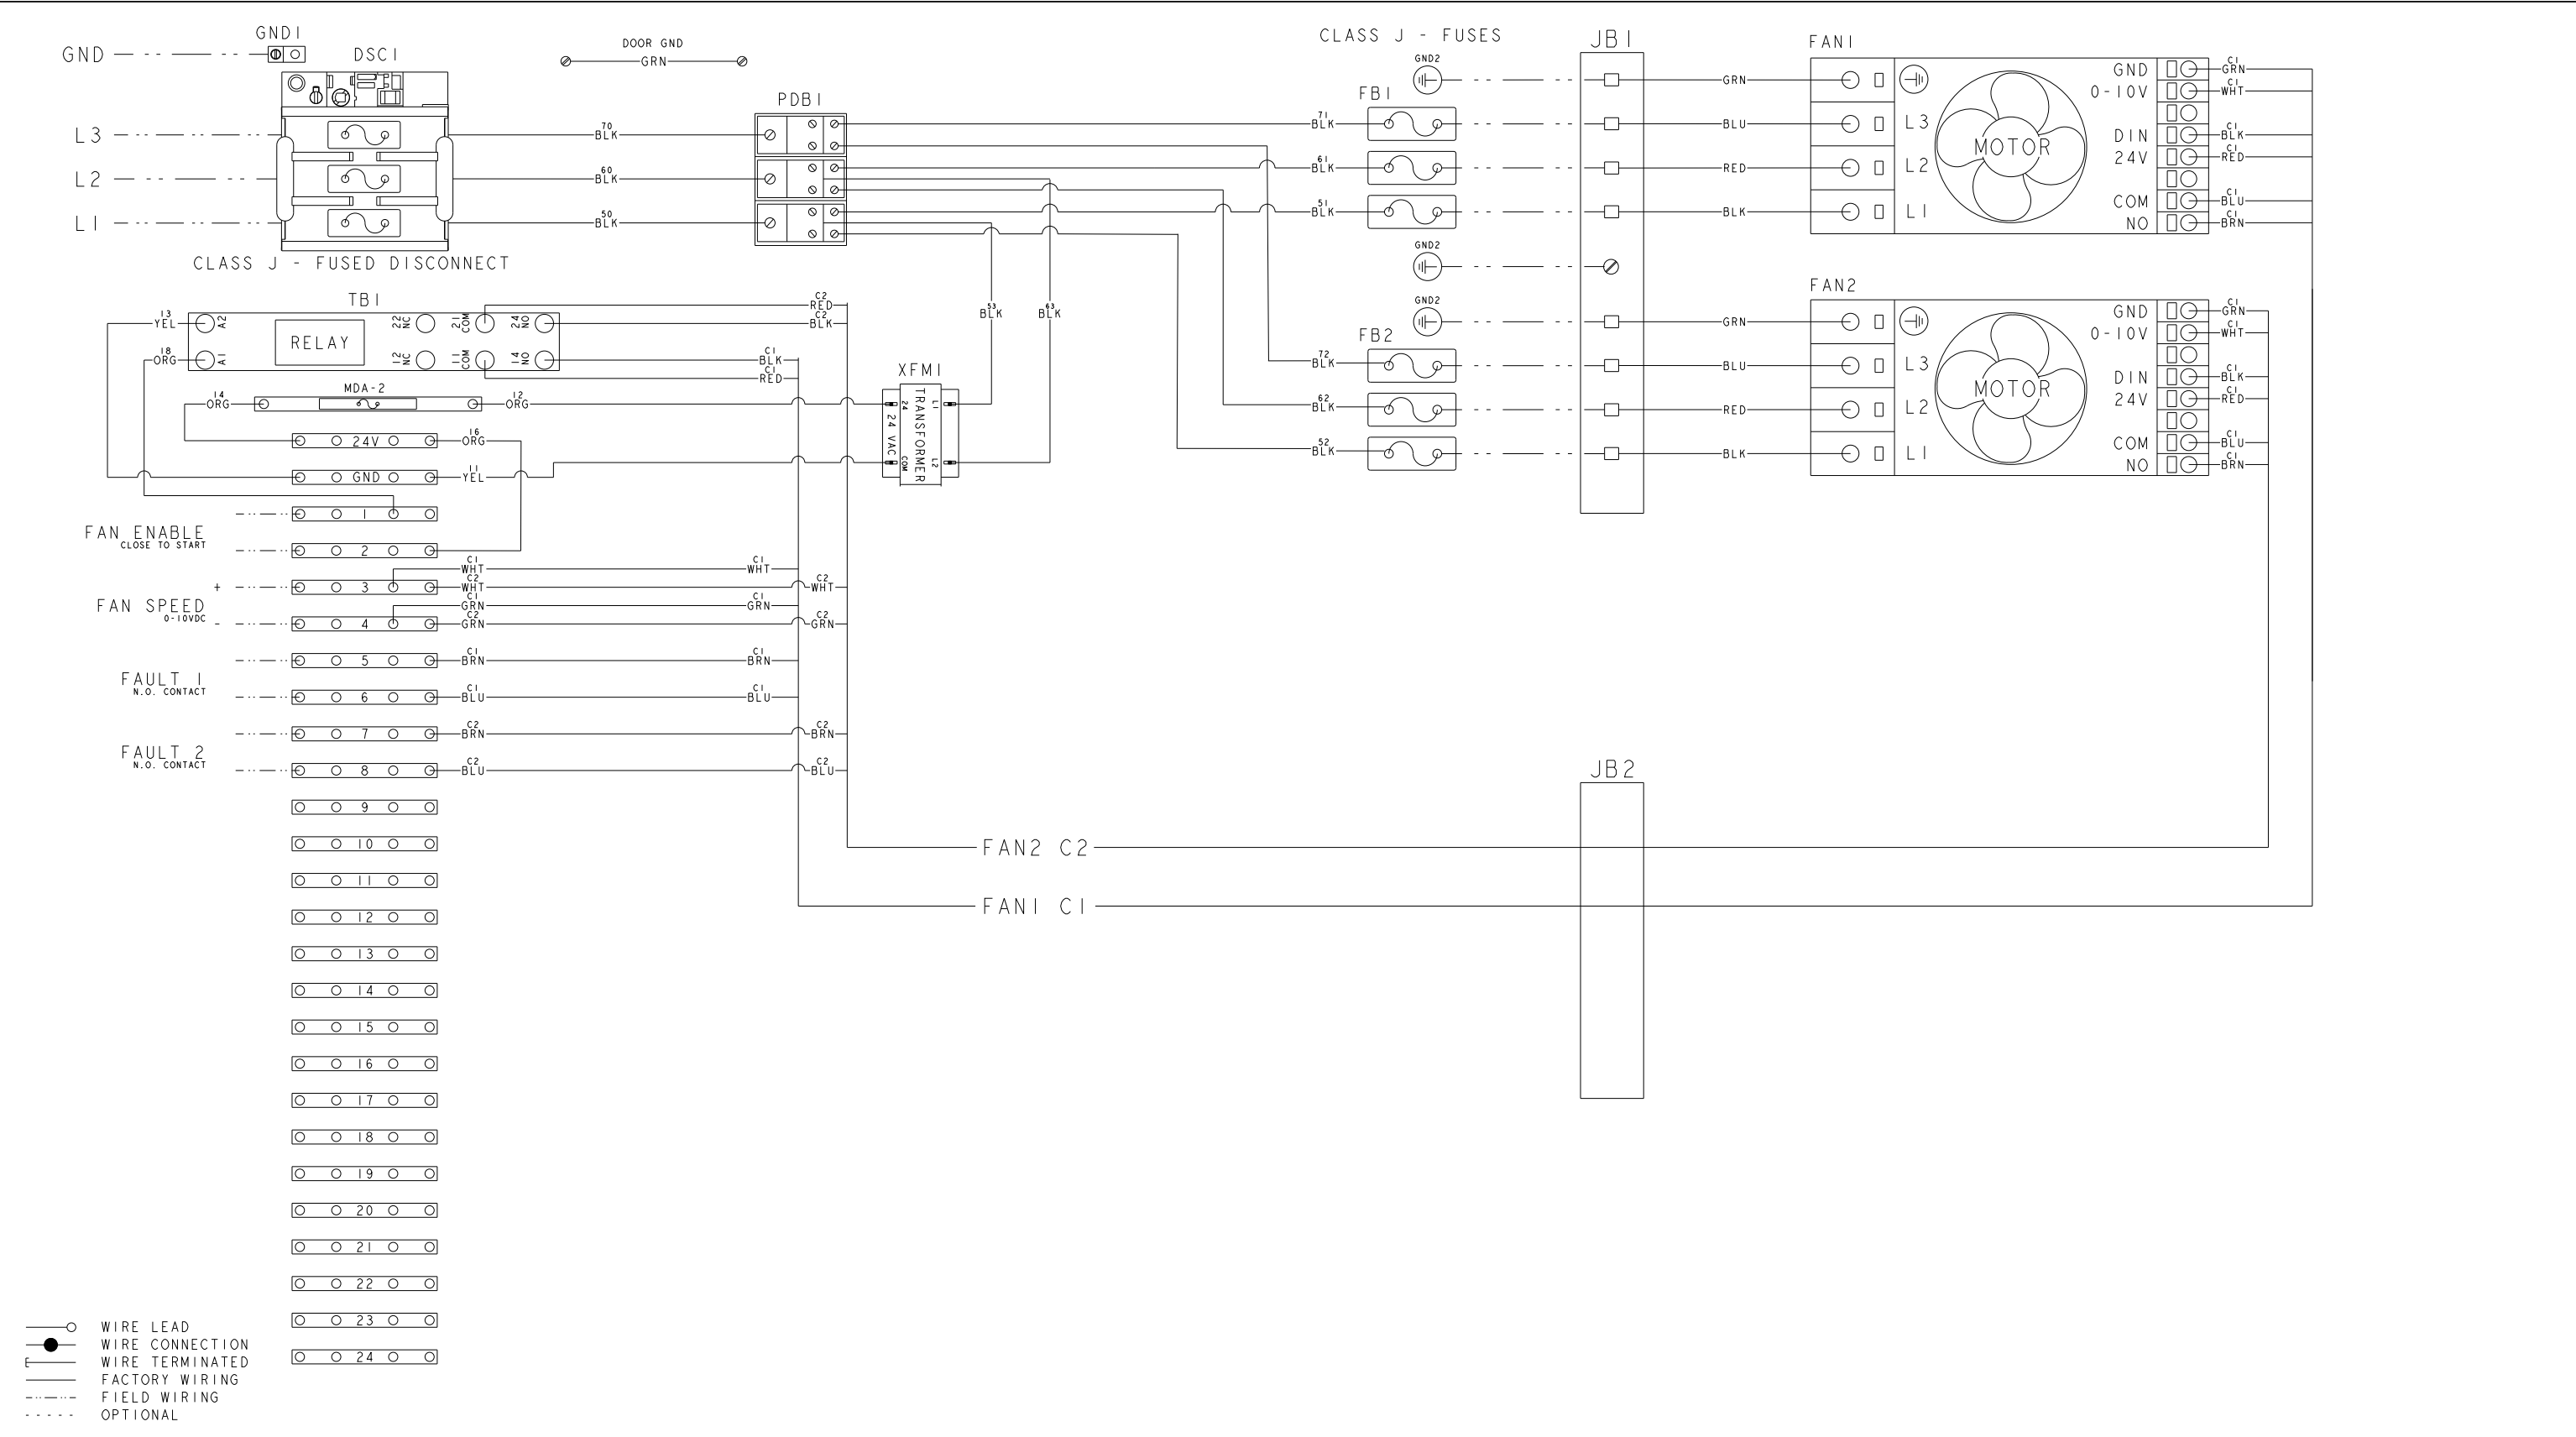

NEC CLASS 2 WIRING

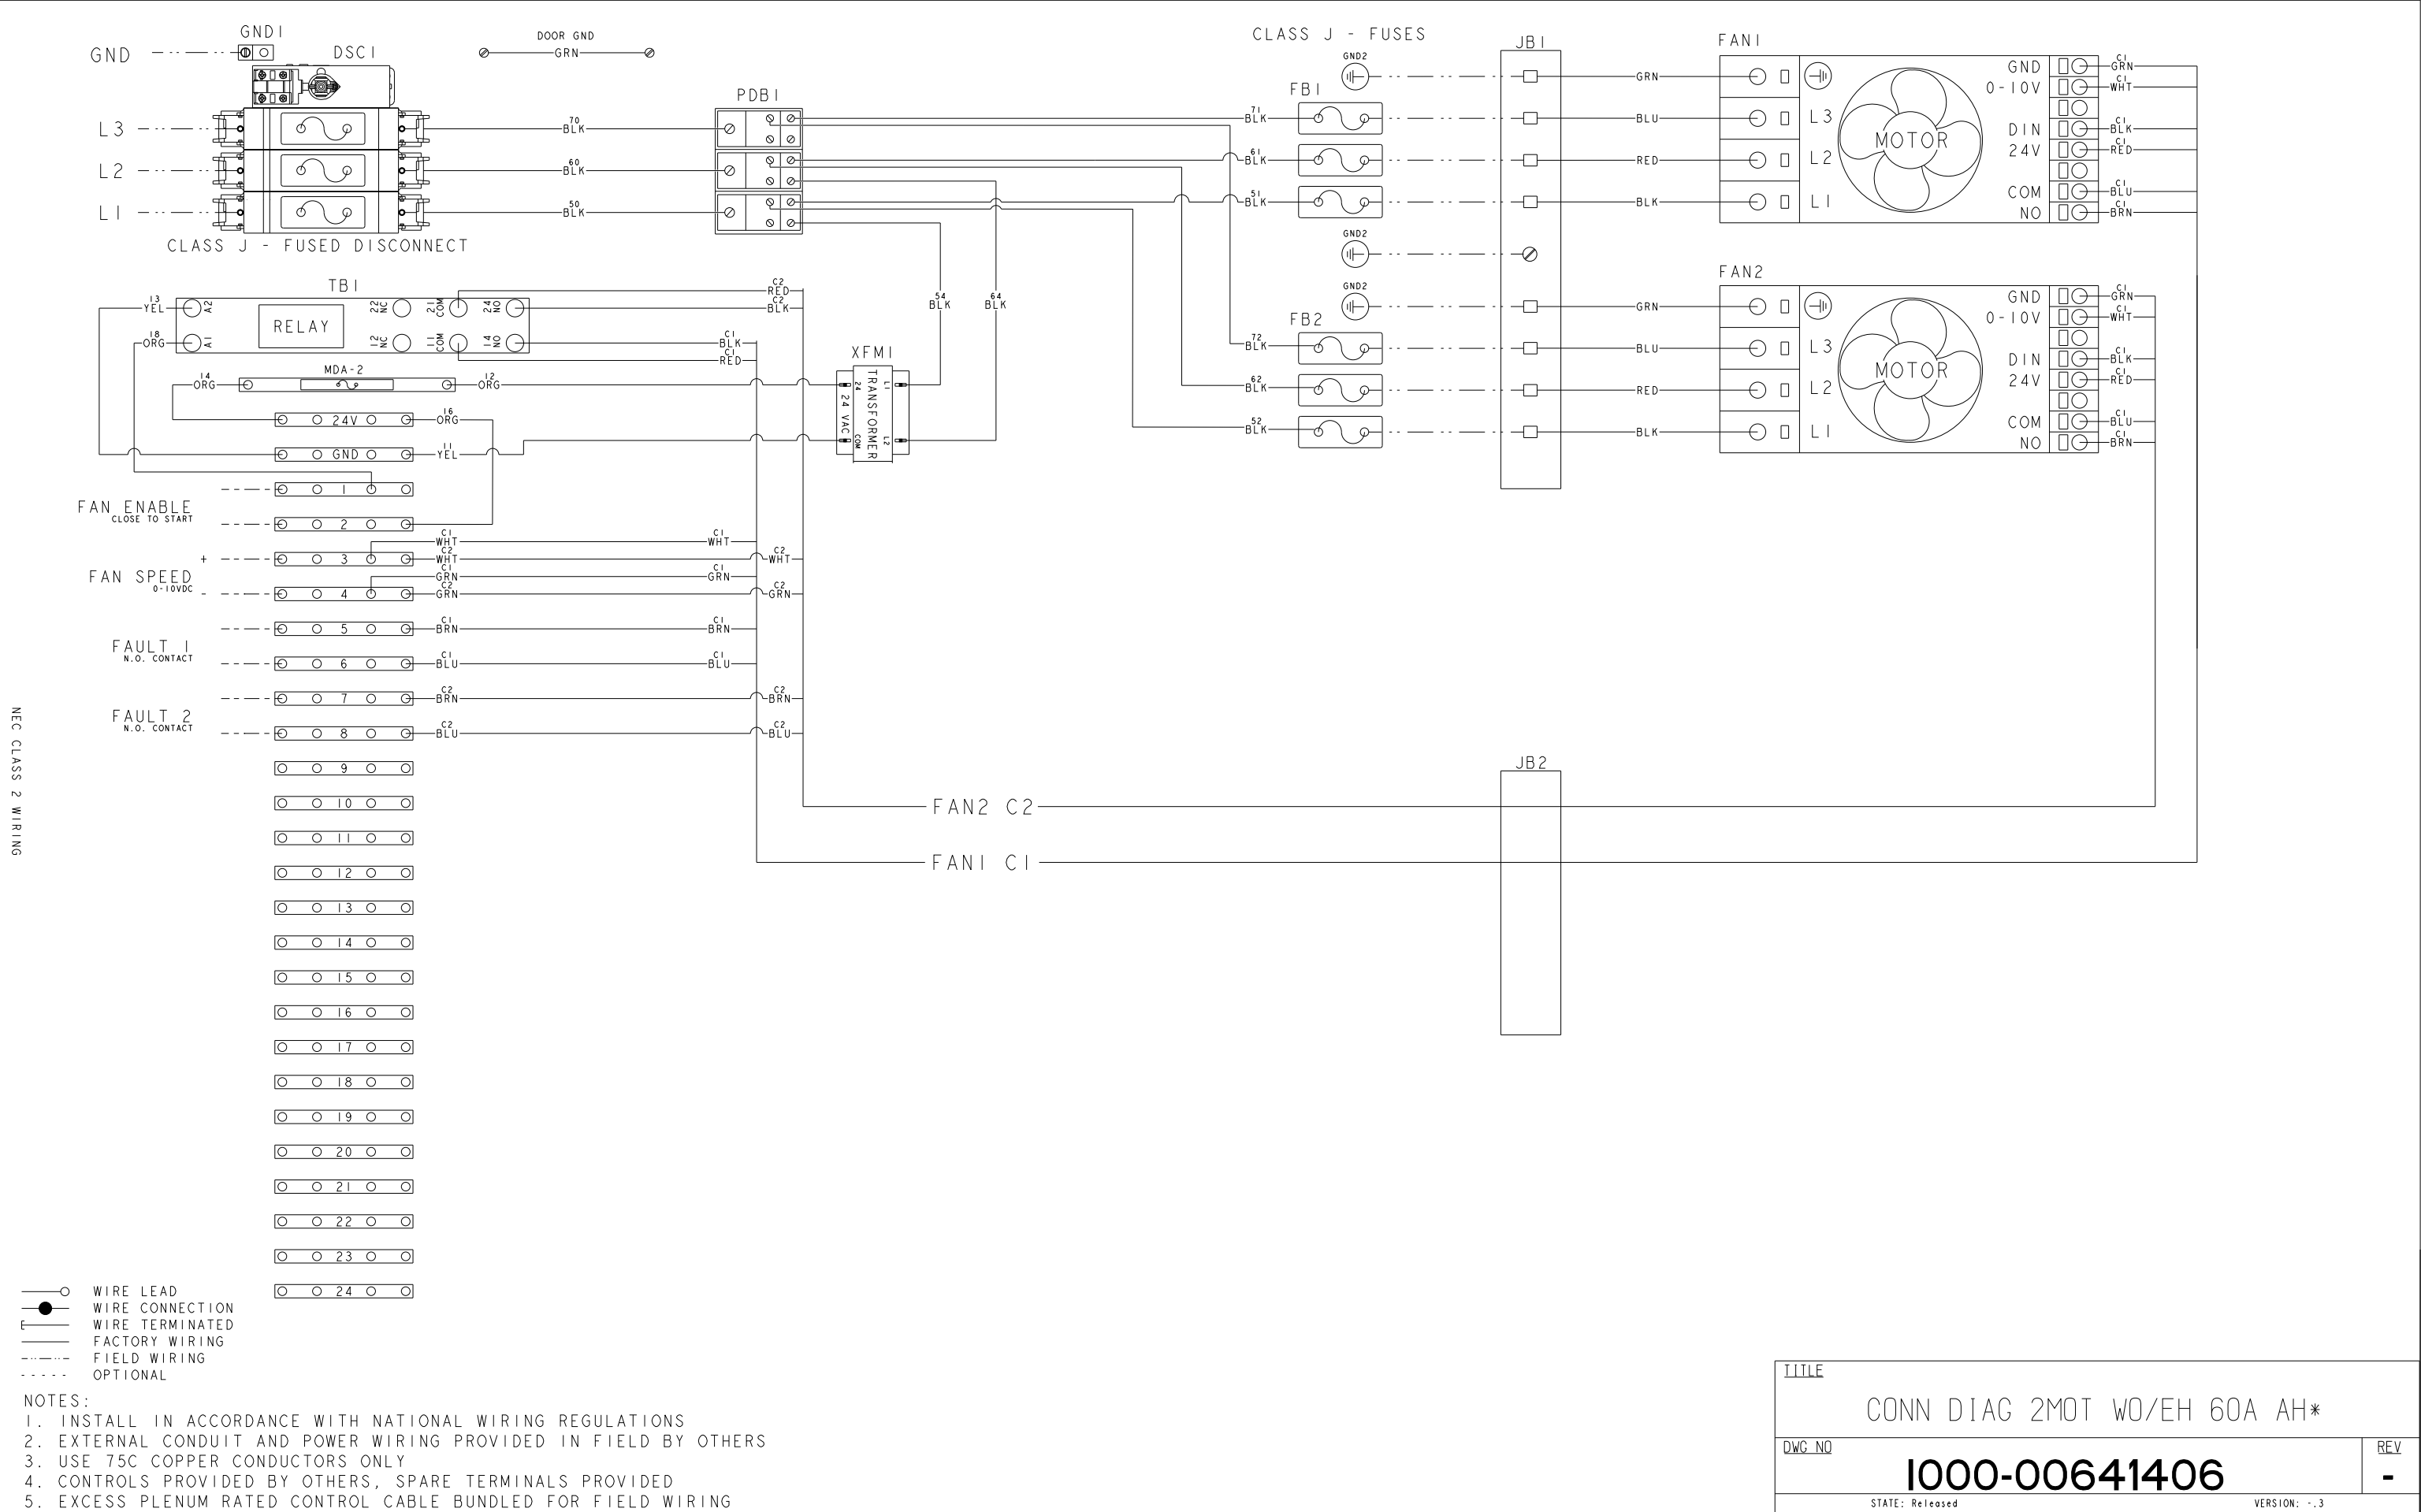


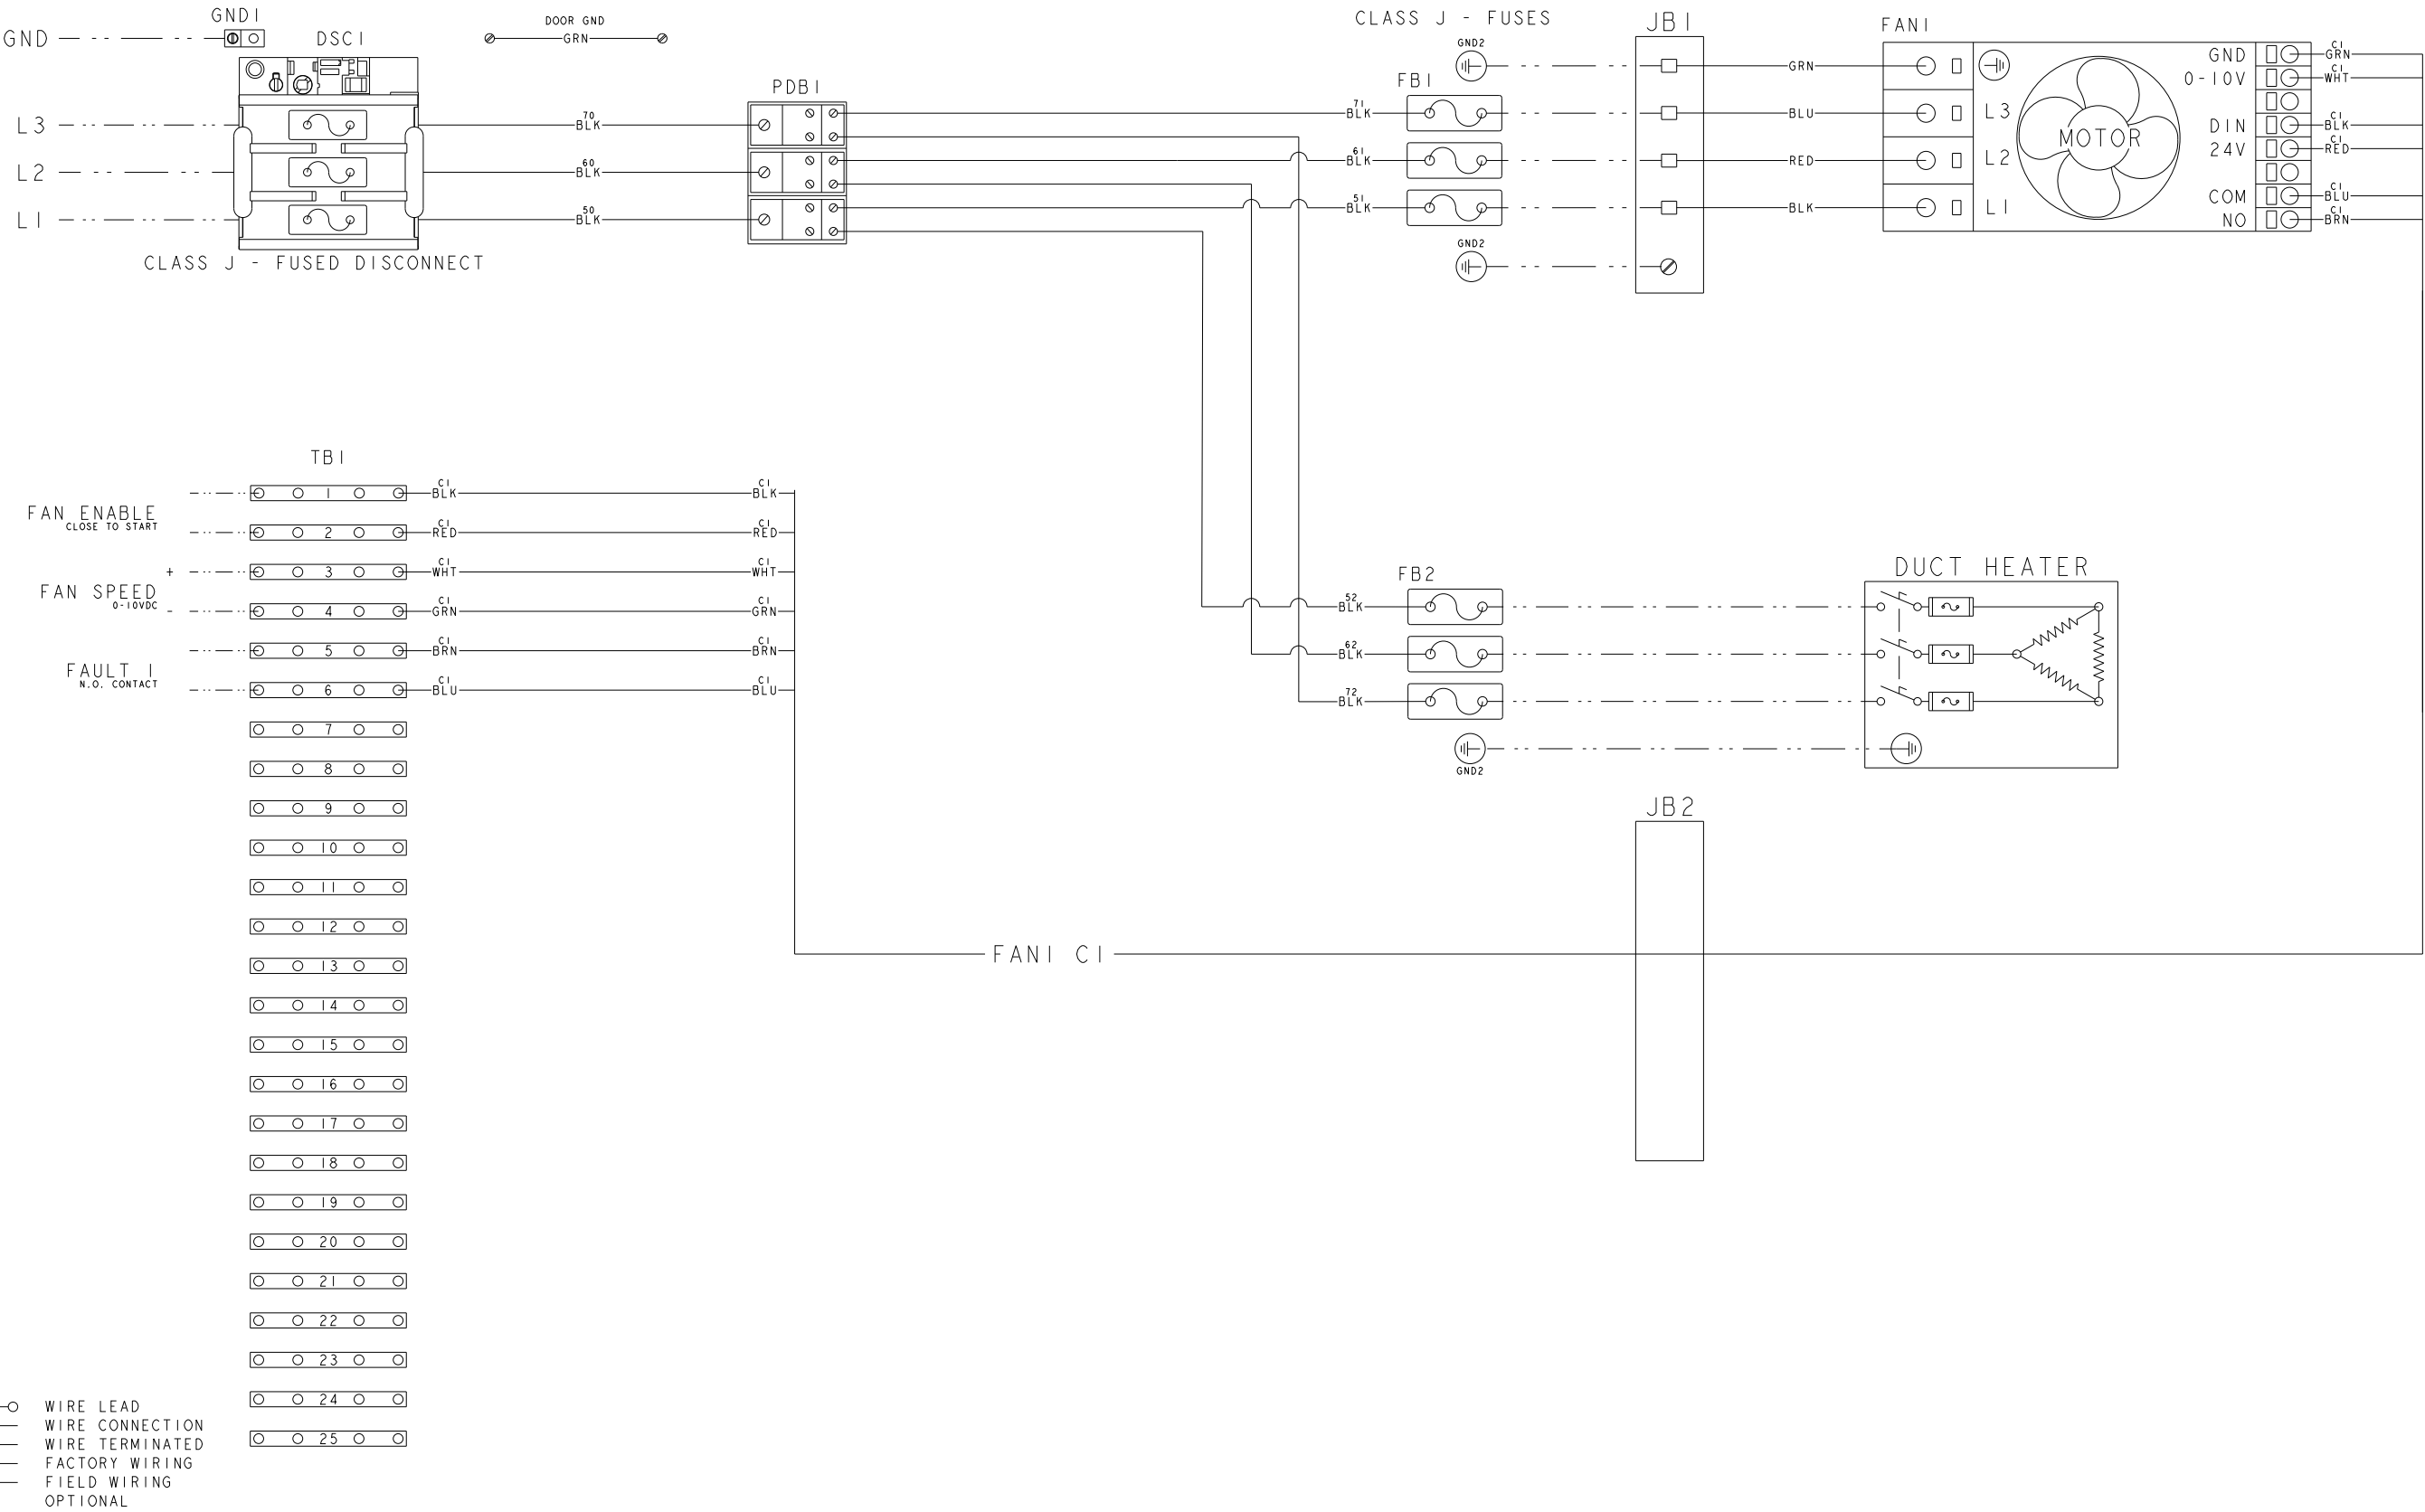

WIRE LEAD
WIRE CONNECTION
WIRE TERMINATED
FACTORY WIRING
FIELD WIRING
OPTIONAL

- NOTES:
1. INSTALL IN ACCORDANCE WITH NATIONAL WIRING REGULATIONS
 2. EXTERNAL CONDUIT AND POWER WIRING PROVIDED IN FIELD BY OTHERS
 3. USE 75C COPPER CONDUCTORS ONLY
 4. CONTROLS PROVIDED BY OTHERS, SPARE TERMINALS PROVIDED
 5. EXCESS PLENUM RATED CONTROL CABLE BUNDLED FOR FIELD WIRING

TITLE		
CONN DIAG 1MOT W/EH 30A AH*		
DWG NO	1000-00643471	REV
STATE: Released		VERSION: -.2

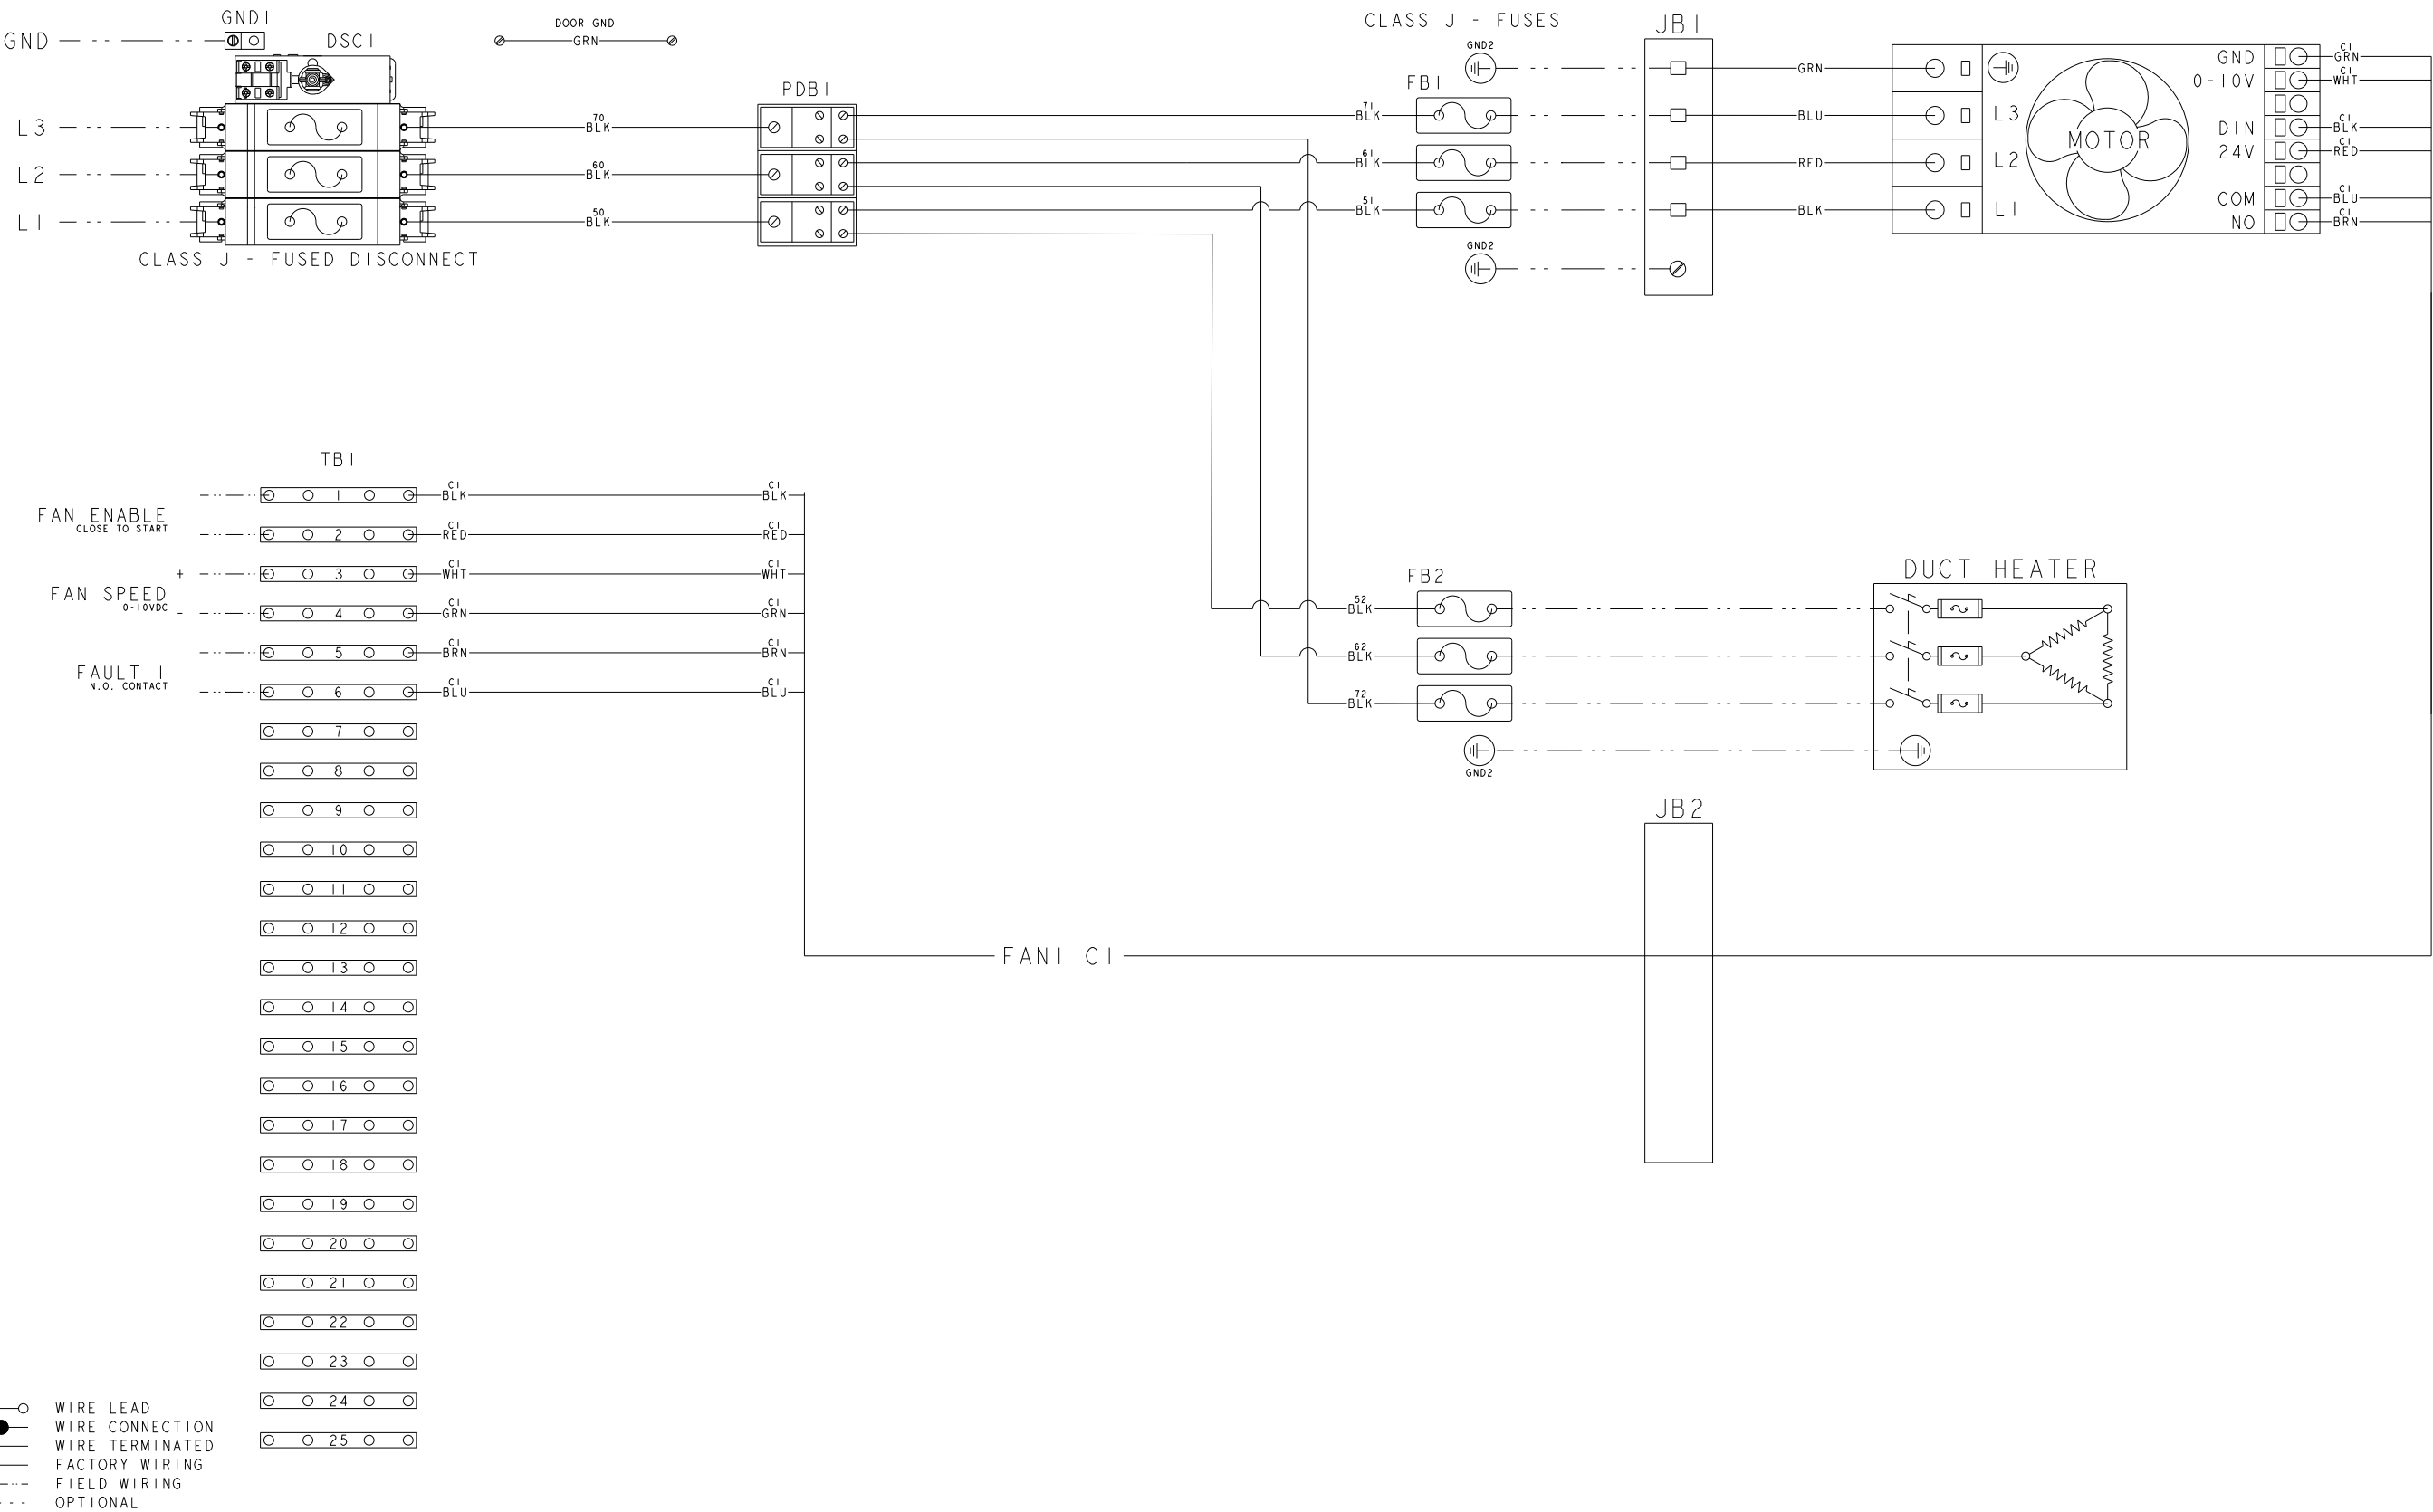


NOTES:

1. INSTALL IN ACCORDANCE WITH NATIONAL WIRING REGULATIONS
2. EXTERNAL CONDUIT AND POWER WIRING PROVIDED IN FIELD BY OTHERS
3. USE 75C COPPER CONDUCTORS ONLY
4. CONTROLS PROVIDED BY OTHERS, SPARE TERMINALS PROVIDED
5. EXCESS PLENUM RATED CONTROL CABLE BUNDLED FOR FIELD WIRING

TITLE		
CONN DIAG 1MOT W/EH 60A AH*		
DWG NO		REV
1000-00642441		-
STATE: Released		VERSION: -.2

NEC CLASS 2 WIRING

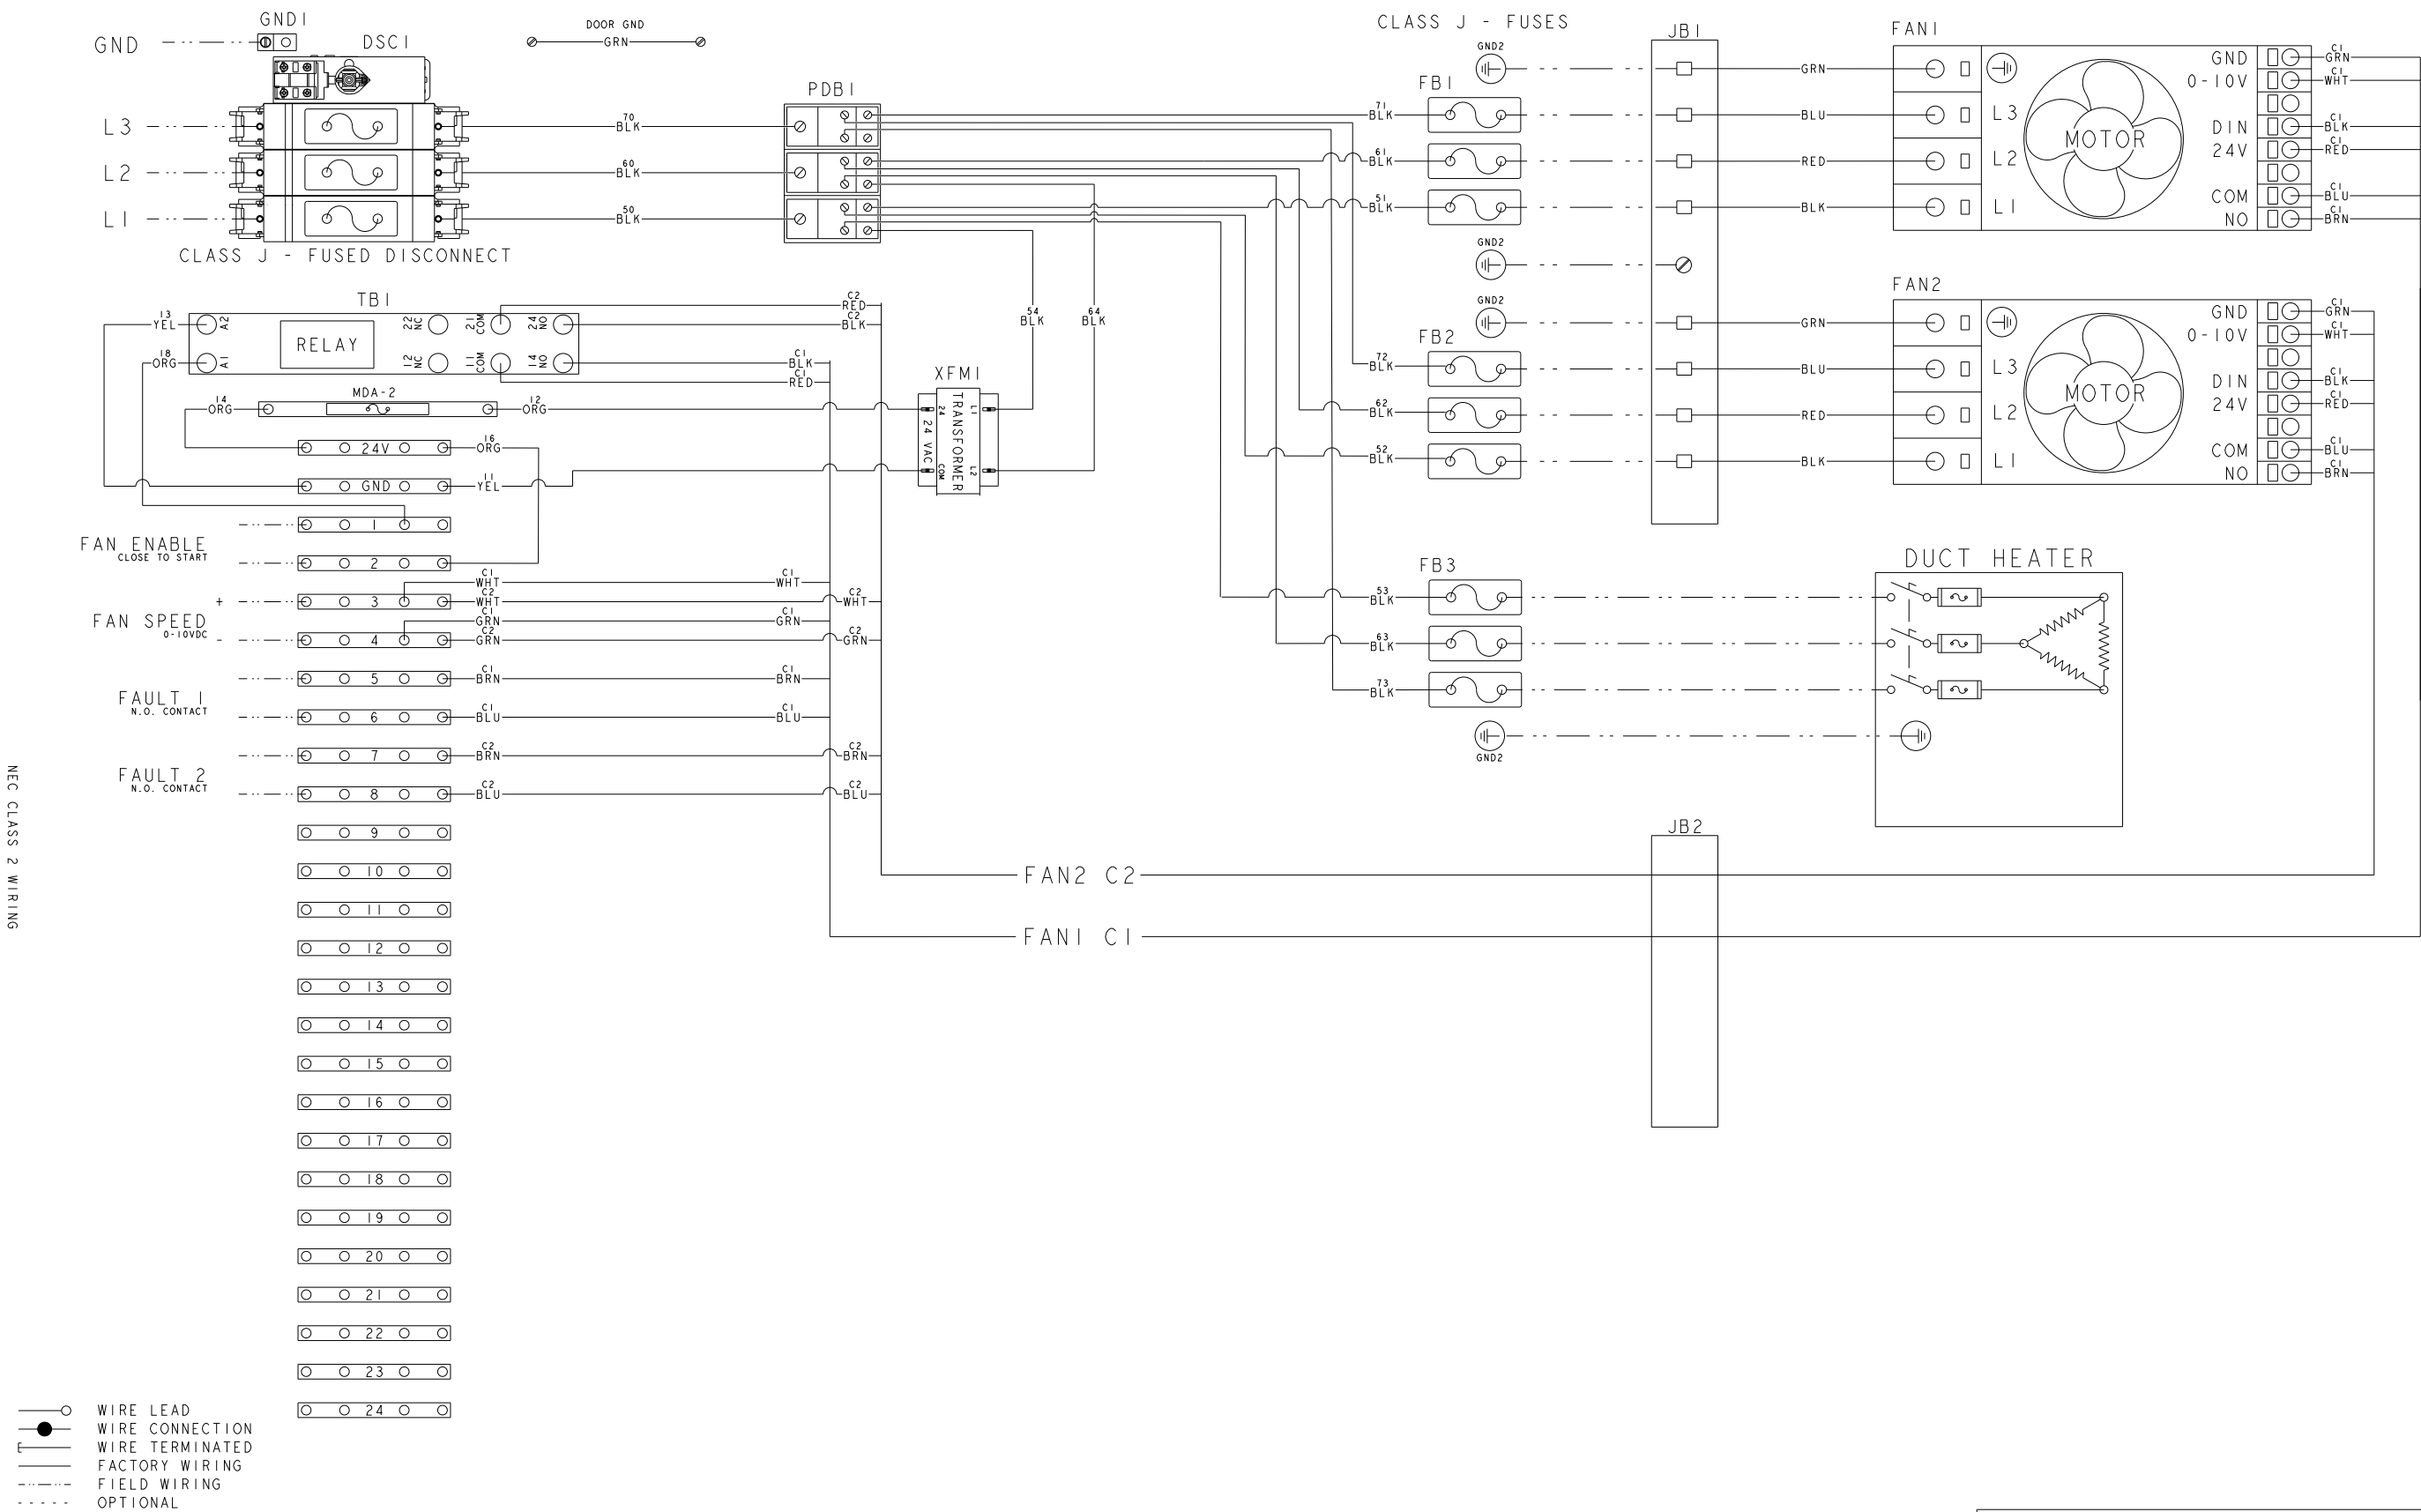

- NOTES:
1. INSTALL IN ACCORDANCE WITH NATIONAL WIRING REGULATIONS
 2. EXTERNAL CONDUIT AND POWER WIRING PROVIDED IN FIELD BY OTHERS
 3. USE 75C COPPER CONDUCTORS ONLY
 4. CONTROLS PROVIDED BY OTHERS, SPARE TERMINALS PROVIDED
 5. EXCESS PLENUM RATED CONTROL CABLE BUNDLED FOR FIELD WIRING

TITLE		
CONN DIAG 2MOT W/EH 60A AH*		
DWG NO	1000-00642451	REV
STATE: Released		VERSION: -.2